


AGNI-System №AE-175

Step-by-step installation instructions:

1. Cut two layers of AGNI-Board to fit around the service.
2. Apply AGNI-Seal full depth into the annular gap around the service.
3. Apply a 30mm x 30mm AGNI-Seal sealant fillet/cone around the cable bundle.

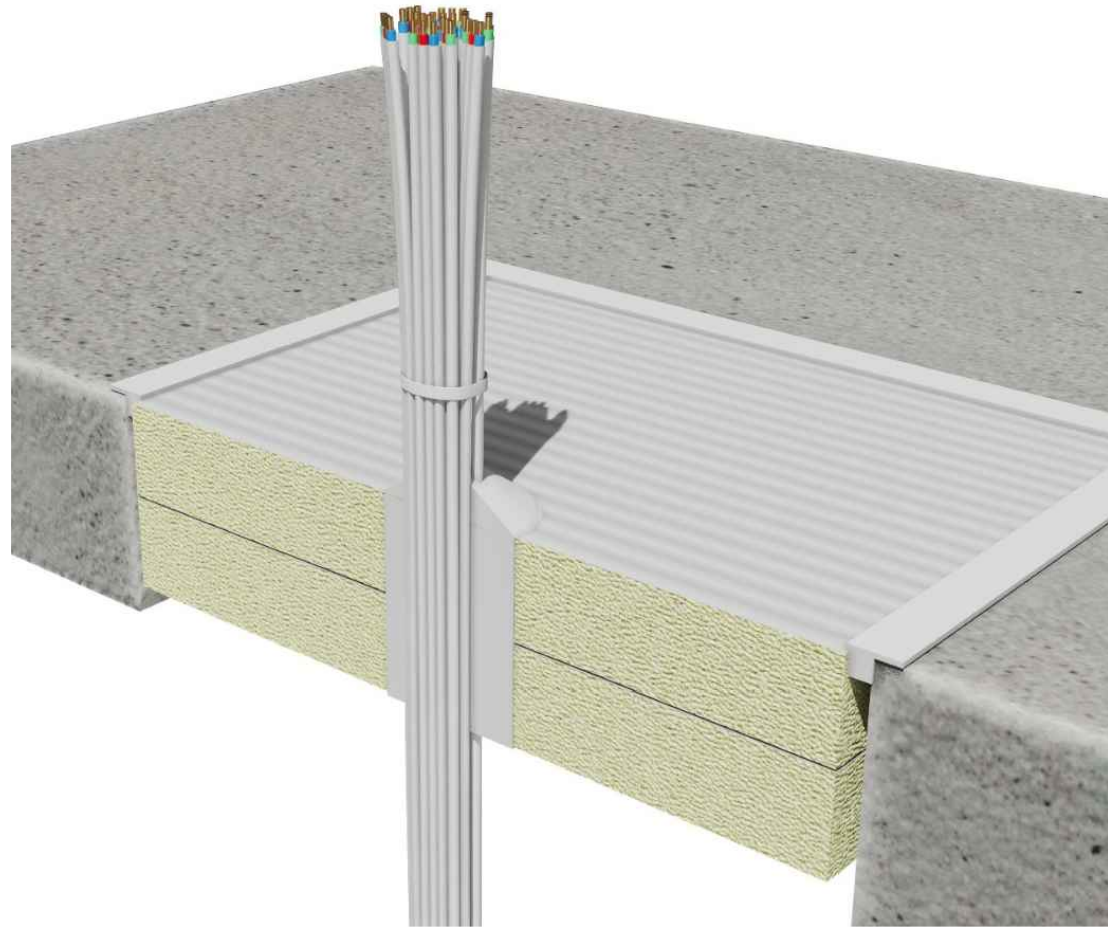

Technical Information

System ID	AE-175
Substrate	2 X layers of AGNI-Board installed in min 120mm concrete floor/ceiling
Service range	10 x TPS cables
Annular gap	2.1 -4.8mm
AGNI-Products	AGNI-Board, AGNI-Seal
Protection installation	Asymmetrical

Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	-/120/120
Reference	PF24142




Agnitek
FIRE RATED TECHNOLOGY

8 Clare St Bayswater
VIC 3153, AUSTRALIA
+61 (03) 7045 4242
info@agnitek.com.au
www.agnitek.com.au

Disclaimer

Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.

Date	03.04.2025
------	------------

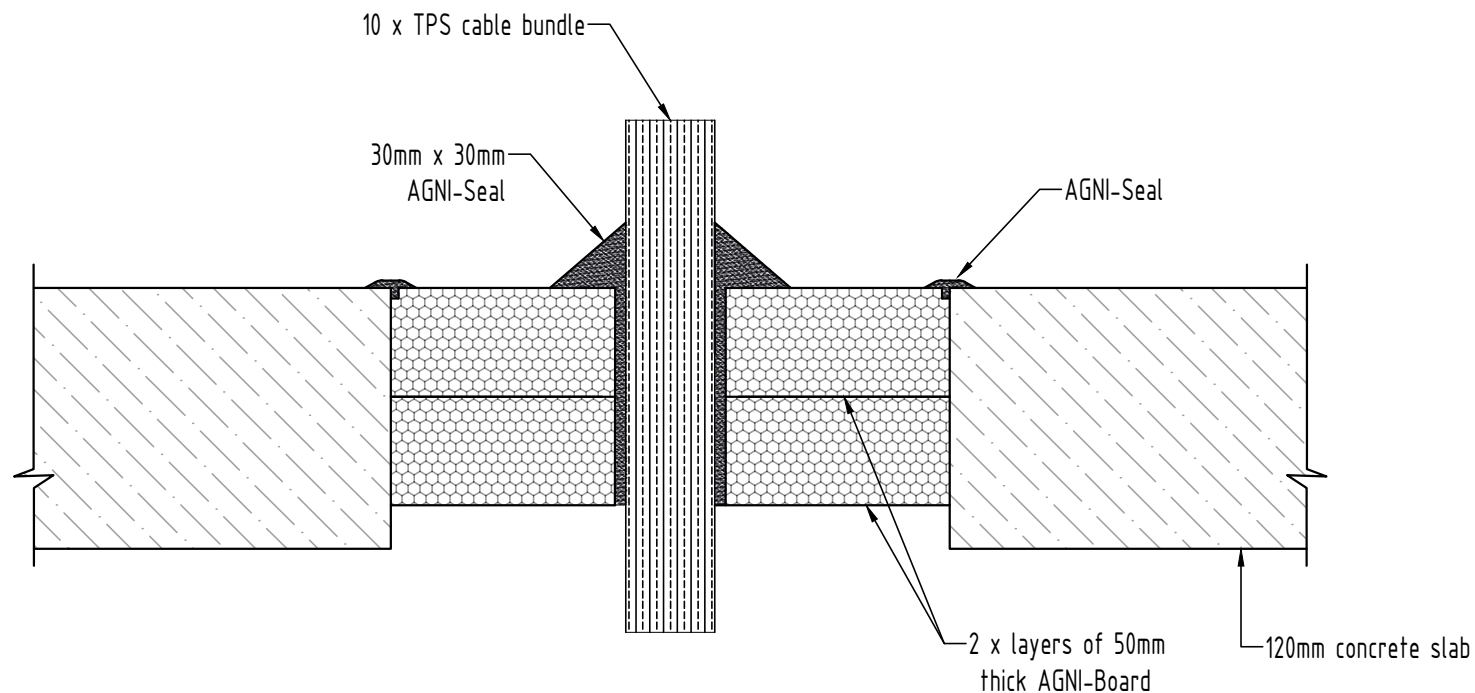

Technical Information

System ID	AE-175
Substrate	2 X layers of AGNI-Board installed in min 120mm concrete floor/ceiling
Service range	10 x TPS cables
Annular gap	2.1 -4.8mm
AGNI-Products	AGNI-Board, AGNI-Seal
Protection installation	Asymmetrical

Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	-/120/120
Reference	PF24142



8 Clare St Bayswater
VIC 3153, AUSTRALIA
+61 (03) 7045 4242
info@agnitek.com.au
www.agnitek.com.au

Disclaimer

Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.

Date	03.04.2025
------	------------