


# AGNI-System NoAP-236

## Step-by-step installation instructions:

1. Apply 13mm (nominal) AGNI-Seal into the annular space and finish flush with the lining on both sides of the wall.
2. Install AGNI-Collar around the service on both sides of the wall and fix to the wall using fire collar screws.

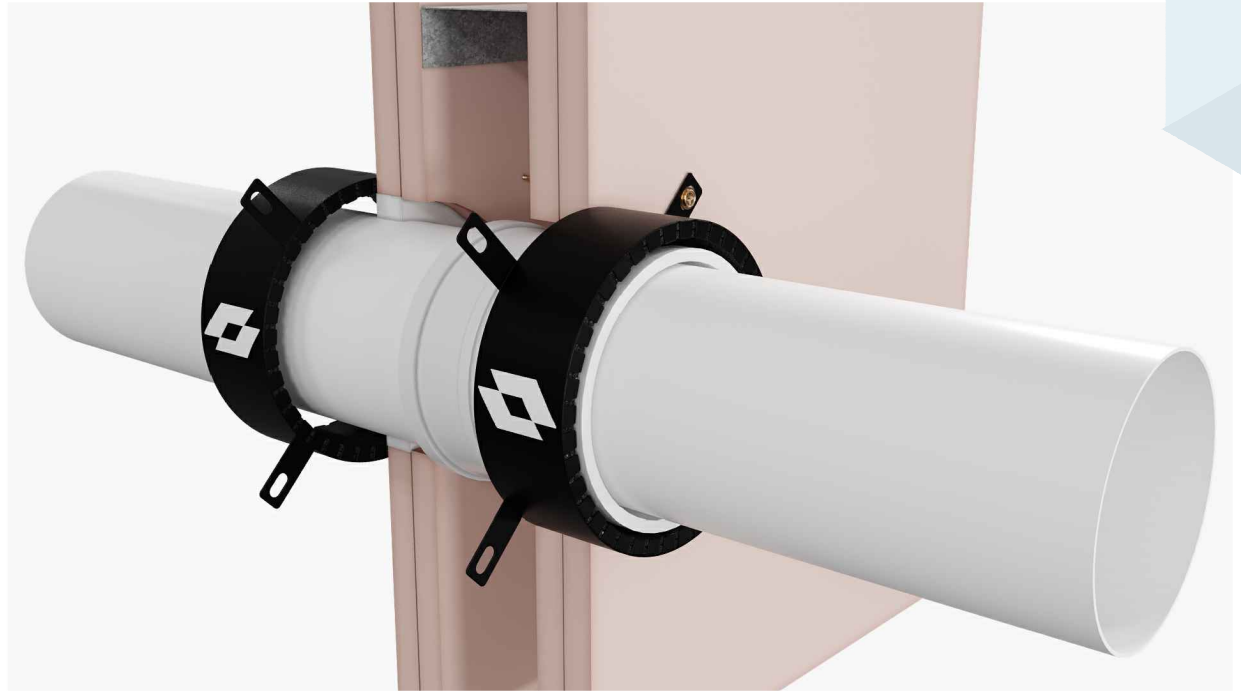

## Technical Information

System ID	AP-236
Substrate	<ul style="list-style-type: none"> <li>• Min. 64mm timber or steel stud wall with a minimum of two layers of 13mm (or greater) FR plasterboard on each side, with or without insulation.</li> <li>• Min. 116mm concrete wall</li> </ul>
Service range	From DN40mm up to DN150mm uPPVC pipes with coupling
Annular gap	DN40mm - 7.1mm DN50mm - 7.1mm DN65mm - 5.6mm DN80mm - 6.3mm DN100mm - 8.5mm DN150mm - 2.5mm
AGNI-Products	AGNI-Collar, AGNI-Seal
Protection installation	From both sides of the wall

## Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	-/120/120
Reference	FRT251395




8 Clare St Bayswater  
VIC 3153, AUSTRALIA  
+61 (03) 7045 4242  
info@agnitek.com.au  
www.agnitek.com.au

### Disclaimer

Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.

Date	15.08.2025
------	------------

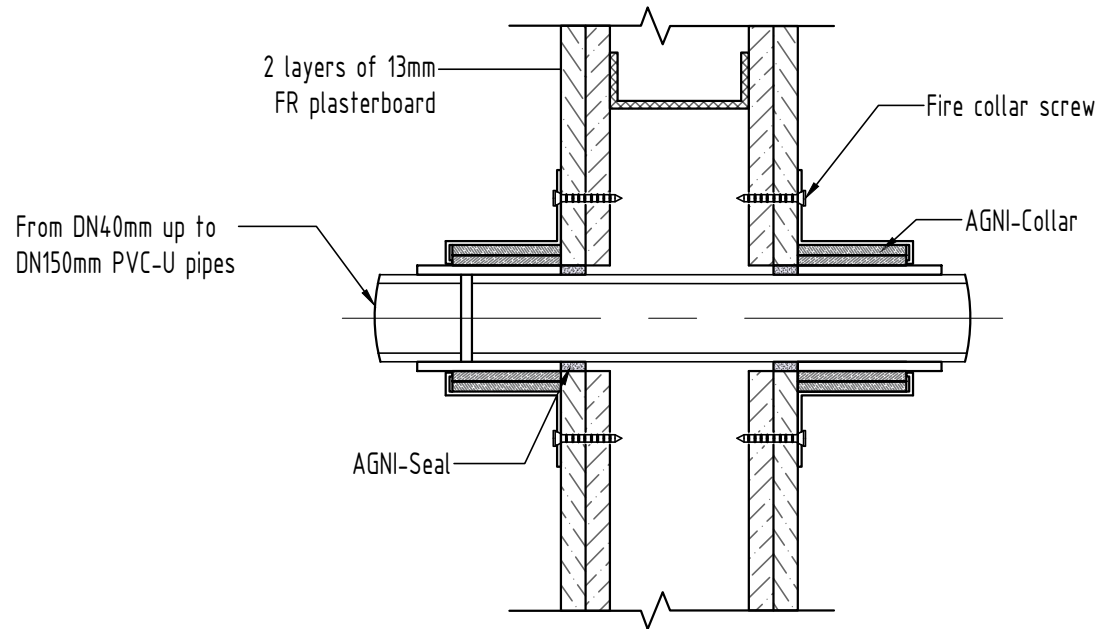

Technical Information

System ID	AP-236
Substrate	<ul style="list-style-type: none"> <li>• Min. 64mm timber or steel stud wall with a minimum of two layers of 13mm (or greater) FR plasterboard on each side, with or without insulation.</li> <li>• Min. 116mm concrete wall</li> </ul>
Service range	From DN40mm up to DN150mm uPPVC pipes with coupling
Annular gap	DN40mm - 7.1mm DN50mm - 7.1mm DN65mm - 5.6mm DN80mm - 6.3mm DN100mm - 8.5mm DN150mm - 2.5mm
AGNI-Products	AGNI-Collar, AGNI-Seal
Protection installation	From both sides of the wall

Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	-/120/120
Reference	FRT251395



**Agnitek**<sup>®</sup>  
FIRE RATED TECHNOLOGY

8 Clare St Bayswater  
VIC 3153, AUSTRALIA  
+61 (03) 7045 4242  
info@agnitek.com.au  
www.agnitek.com.au

Date 15.08.2025

**Disclaimer**  
Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.