

AGNI-System №AP-264

Step-by-step installation instructions:

1. Apply 10mm (nominal) deep AGNI-Seal around the pipe on both sides of the floor.
2. Install AGNI-Collar40 around the socket portion of the service on the exposed side and fix to the floor using masonry screws.



Technical Information

System ID	AP-264
Substrate	<ul style="list-style-type: none"> • Min. 150mm concrete floor/ceiling
Service range	DN40mm HDPE pipe with electrofusion coupling
Annular size	3.5mm
AGNI-Products	AGNI-Collar40, AGNI-Seal
Protection installation	Asymmetrical

Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	-/180/180
Reference	FRT251100





8 Clare St Bayswater
VIC 3153, AUSTRALIA
+61 (03) 7045 4242
info@agnitek.com.au
www.agnitek.com.au

Date 15.08.2025

Disclaimer

Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.

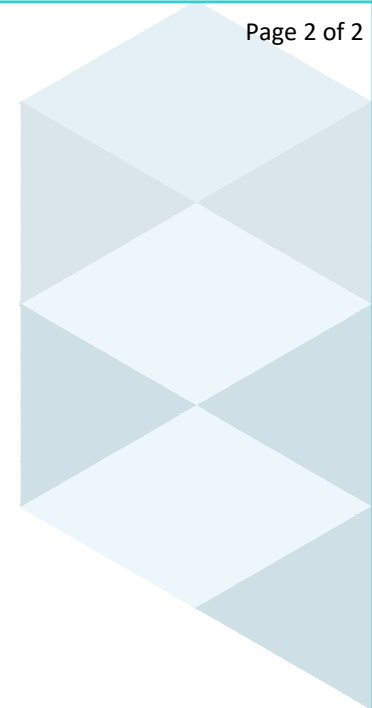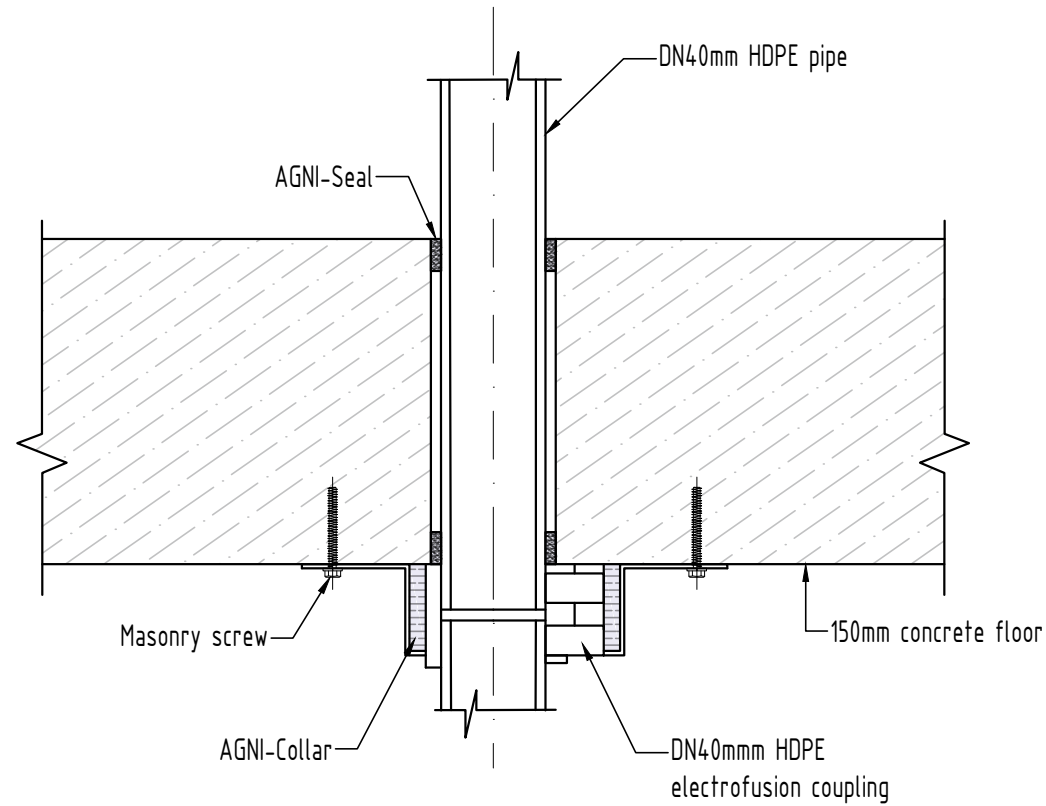

Technical Information

System ID	AP-264
Substrate	<ul style="list-style-type: none"> Min. 150mm concrete floor/ceiling
Service range	DN40mm HDPE pipe with electrofusion coupling
Annular size	3.5mm
AGNI-Products	AGNI-Collar40, AGNI-Seal
Protection installation	Asymmetrical

Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	-/180/180
Reference	FRT251100



8 Clare St Bayswater
 VIC 3153, AUSTRALIA
 +61 (03) 7045 4242
 info@agnitek.com.au
 www.agnitek.com.au

Disclaimer

Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.

Date	24.05.2025
------	------------